



New Multifamily Construction Request for Elevated Pressure (2 PSIG)



Project Name:	
Project Address:	
Project City:	
Number of Dwelling Units:	Number of Dwelling Structures:

Builder Name
Builder Address
Contact Person

PROGRAM QUALIFICATIONS

Approval is based upon the builder complying with all of the following qualifications (initials **REQUIRED**):

Builder initial here

- Individual dwelling unit metering is **REQUIRED**.
- Multiple pressure systems on the same manifold are not permitted.
- House line stubs at meter manifold to be 3/4 inch solid pipe fittings secured properly to hold a minimum of 10 lbs. of weight.
- A Continuous Service Agreement is **REQUIRED** for rental projects.

Builder agrees to install a minimum of 5 natural gas end uses (initials **REQUIRED**):


Builder initial here

- REQUIRED - Individual Water Heater & Space Heater** (Furnace or Hydronics System) within each dwelling unit
- Cook Top** and/or **Oven** free standing or slide in natural gas range qualifies as 2 end uses
- Clothes Dryer** central laundry facility with gas dryers qualifies as an end use per dwelling unit
- Fireplace with Decorative Gas Logs, Log Lighter or Stub Installed**
- Patio Stub** for use with outdoor natural gas appliances, i.e. barbecue central barbecue in recreation area qualifies for one end use per dwelling unit

Approval is based upon the builder complying with all of the listed qualifications. Acceptable locations for regulators, shut-off valves, manifolds, and pressure tap outlets are as follows (initials **REQUIRED**):

Builder initial here

- Builder shall install step-down regulator manifold in ventilated locations that have adequate room to work (2-foot clearance front and sides). Regulators must be reached safely between 3 and 5 feet above ground level. Examples of suitable locations provided the above guidelines are followed: garage, water heater closet, utility room, and outside wall of the unit it is serving. **Attic installations are unacceptable.**
- Builder shall install a shut-off valve, step-down regulator, union and bypass tee (to be used as a pressure tap) as per step-down regulator manifold diagram.
- Step-down regulators are suitable for multi-position mounting when using a vent line. However, when using a vent-limiting device, the regulator must be mounted in a horizontal upright position.

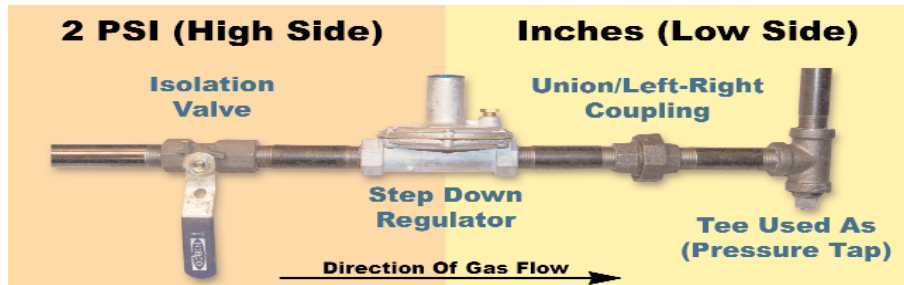

My signature represents my understanding that failure to install the required gas equipment listed above and follow the step-down regulator and/or manifold installation specifications as listed above, will result in one of the following actions by Southern California Gas Company: *refusal to provide 2 PSIG, or provide 2 PSIG after receipt of Special Facility and Cost Of Ownership payments.* ***ALL FIELDS IN SHADED AREA BELOW ARE REQUIRED.**

PRINT NAME	TITLE
SIGNATURE	DATE
EMAIL	FAX
PHONE	CELL

SoCalGas Use Only

Line Extension Manager Approval: _____ Date: _____
 Field Planning Associate: _____ Project Manager: _____
 Customer Service Supervisor: _____
 Project Site Visit Completed By: _____ Date: _____